







# Fire Test Certificate – Specimen

**Fabric:** Joelmat  
**Type:** EN13501-1

# J&C Joel

the inspiration behind the performance

 **ÖTI – Institut für Ökologie, Technik und Innovation GmbH**

**Report 66002**  
**Classification Report on Burning Behaviour**

<b>Applicant</b>	<b>Reference</b>

**Application**

2. extension of the period of validity of the classification 44074.

**Test Material**



"Unifloor 030/I"

Material used in testing was anonymized for laboratory purposes. A detailed sample list is contained in the report.

**Issuing and Signatures**


Number of pages contained: 6  
Original Issue / Vienna 2011-06-01 / Rm/AM/KK 3149

Authorised for Institute  
DI (FH) Angelika Hönecke

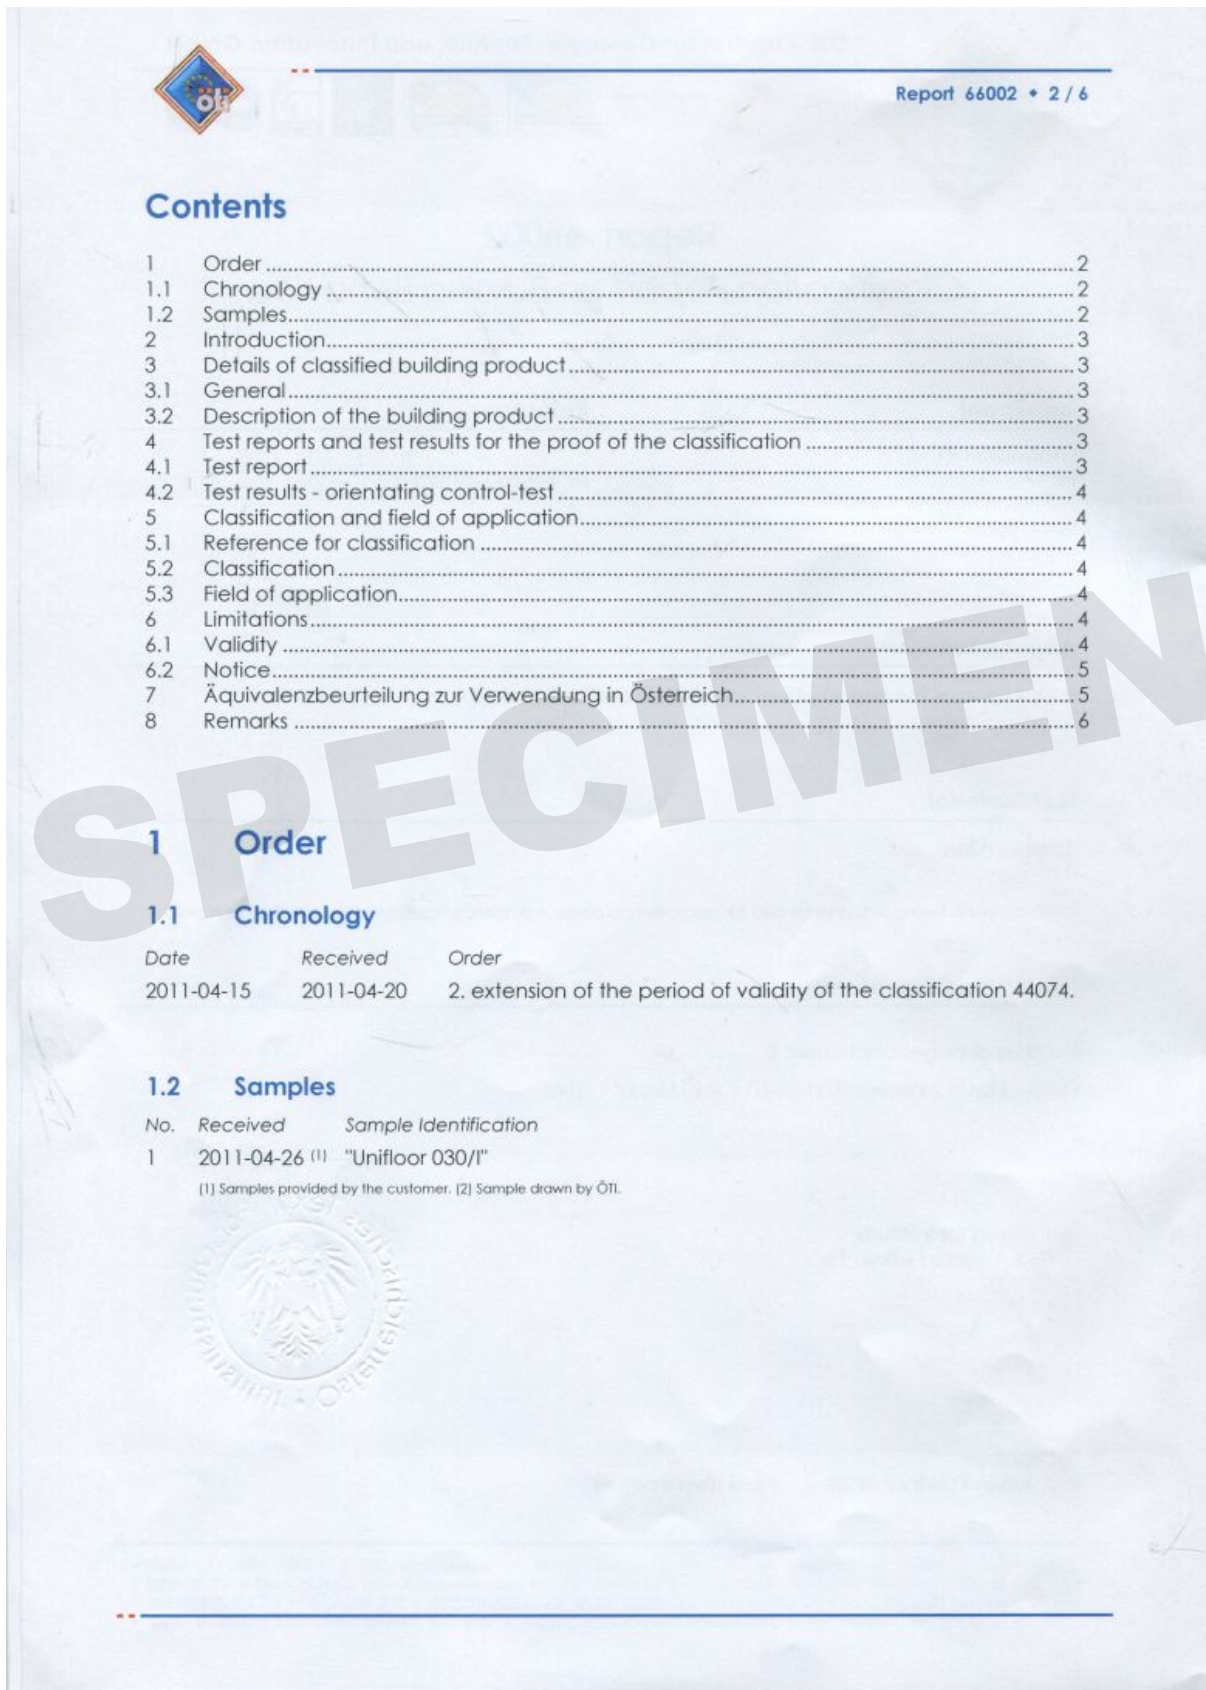
Technology  
Ing. Judith Pointner ☎ 28 / pointner@oeti.at

---

 • ÖTI – Institut für Ökologie, Technik und Innovation GmbH • Spengergasse 20 • A-1050 Wien • Austria •  
• Tel. +43 1 5442543-0 • Fax +43 1 5442543-10 • Email office@oeti.at • Web www.oeti.at • FN: 326826b • UID-Nr ATU65149029 •  
• UniCredit Bank Austria AG • BLZ 12000 • Konto 23410378800 • Iban AT941200023410378800 • Swift BKAUATWW • Eori ATEOS1000015903 •  
• Es gelten ausschließlich unsere Allgemeinen Geschäftsbedingungen • Only our General Terms and Conditions apply •

# Fire Test Certificate – Specimen

**Fabric:** Joelmat  
**Type:** EN13501-1



## Contents

1	Order .....	2
1.1	Chronology .....	2
1.2	Samples .....	2
2	Introduction .....	3
3	Details of classified building product .....	3
3.1	General .....	3
3.2	Description of the building product .....	3
4	Test reports and test results for the proof of the classification .....	3
4.1	Test report .....	3
4.2	Test results - orientating control-test .....	4
5	Classification and field of application .....	4
5.1	Reference for classification .....	4
5.2	Classification .....	4
5.3	Field of application .....	4
6	Limitations .....	4
6.1	Validity .....	4
6.2	Notice .....	5
7	Äquivalenzbeurteilung zur Verwendung in Österreich .....	5
8	Remarks .....	6

## 1 Order

### 1.1 Chronology

Date	Received	Order
2011-04-15	2011-04-20	2. extension of the period of validity of the classification 44074.

### 1.2 Samples

No.	Received	Sample Identification
1	2011-04-26 <sup>(1)</sup>	"Unifloor 030/I"

(1) Samples provided by the customer. (2) Sample drawn by ÖTI.



## 2 Introduction

This classification report defines the classification assigned to the building product "Unifloor 030/I" in accordance with the test methods fixed in EN 13501-1.

An orientating control-test of the burning behaviour of the submitted sample was performed. (See pt. 4.2)

## 3 Details of classified building product

### 3.1 General

The building product "Unifloor 030/I" is defined as flooring, the classification is valid for the end use application described under point 5.3.

### 3.2 Description of the building product

Material (of wear layer):	PVC (according to the specification by the applicant)
Construction:	heterogeneous
Kind of wearlayer:	non transparent wear layer
Structure of wearlayer:	smooth floor covering
Colouring:	plain (single coloured)
Dimensions:	rolls
Type of floor covering:	PVC floor covering with foam layer according to EN 651

	specification by ÖTI	specification by the applicant
Total mass	1260 g/m <sup>2</sup>	1300 g/m <sup>2</sup>
Total thickness	1.8 mm	2.0 mm
Density	--	1250 kg/m <sup>3</sup>

The applicant of this classification report guarantees the observance of the instructions of the product specification according to EN 651.

## 4 Test reports and test results for the proof of the classification

### 4.1 Test report

Laboratory	ÖTI
Test report number	<b>44074</b>
Date of issue of the classification report	<b>29<sup>th</sup> July 2003</b>
Applicant	<b>Graboplast Rt</b>
Test methods	EN ISO 11925-2 and EN ISO 9239-1

# Fire Test Certificate – Specimen

Fabric: Joelmat  
Type: EN13501-1



Report 66002 + 4 / 6

## 4.2 Test results - orientating control-test

	Test results	Number of tests
<b>Burning behaviour, EN ISO 9239-1</b>		
Critical radiant flux	≥ 11 kW/m <sup>2</sup>	1
Integral of smoke obscuration	95 %min	1

## 5 Classification and field of application

### 5.1 Reference for classification

This classification was carried out within the scope of the classification report **44074** from **29<sup>th</sup> July 2003** in accordance with EN 13501-1 pt. 11 and 12.2.

### 5.2 Classification

Due to the results of the orientating control-test which was carried out, the primordial classification of the building product "**Unifloor 030/I**" is approved.

Burning behaviour	Smoke emission
C <sub>fl</sub>	s1
<b>Classification</b>	
C <sub>fl</sub> -s1	

### 5.3 Field of application

The classification is valid for the building product described in point 3 under the following end use conditions.

Application	Horizontal laid floor covering in form of rolls
Subfloors	Not burnable subfloors of euroclass A1 <sub>fl</sub> or A2 <sub>fl</sub> with a density of at least 1350 kg/m <sup>3</sup> .
Installation	glued
Adhesive	Dispersion adhesive Eurocol 643 or similar Note: According to EN13501-1 the stated classification is valid for the tested floor covering together with the tested adhesive, as well as for all other adhesives of the same generic type as the tested adhesive.

## 6 Limitations

### 6.1 Validity

Based on the present documents and the results of the performed control-test the validity of the classification report **44074** can be confirmed.

The report stays valid as long as the products are produced in unchanged condition; this is in the responsibility of the manufacturer.



## 6.2 Notice

This classification document does not represent type permission or certifying the product.

If a building product should be CE marked according to system 3 of the attestation of conformity systems, the classification stated with this report is suitable as a basis for the declaration of the producer according to the attestation of conformity system 3, together with a CE marking in the context of the directive relating to construction products.

If the manufacturer plans a CE marking in connection with conformity system 3, he has to give an explanation, which has to be attached to the relevant documents. This explanation confirms, that there are no the specific materials, production processes or procedures (e.g. no additives of flame retarding materials, delimitation of organic components or additions of fillers), which are improving the burning behaviour to reach the obtained fire classification. As a consequence from this, the manufacturer drew the conclusion that the system 3 of the attestation of conformity systems is appropriate.

The testing laboratory therefore has played no role in the sampling procedure, although the testing laboratory keeps appropriate references from the manufacturer ready, in order to pursue the examined samples.

## 7 Äquivalenzbeurteilung zur Verwendung in Österreich

Unter Zugrundlegung der Anforderungsbedingungen ist eine eindeutige Zuordnung der ehemaligen österreichischen Brandklassifizierung zu einer europäischen Klasse nicht immer möglich und bedarf umfassender Einstufungserfahrung.

Die vorliegende Äquivalenzbeurteilung soll als Hilfestellung verstanden werden die zeigen soll, in welche europäische Klasse ein Bauprodukt fallen kann, das gemäß österreichischen Normen eingestuft wurde und umgekehrt.

Einstufung gemäß EN 13501-1	Anforderungen aus landesgesetzlichen Bestimmungen	
A1 <sup>II</sup>	nichtbrennbar, schwachqualmend	A
A2 <sup>II</sup> -s1		
B <sup>II</sup> -s1	schwerbrennbar, schwachqualmend	B1
C <sup>II</sup> -s1		
D <sup>II</sup> -s1	normalbrennbar, schwachqualmend	B2
A2 <sup>II</sup> -s2		
B <sup>II</sup> -s2		
C <sup>II</sup> -s2		
D <sup>II</sup> -s2		
E <sup>II</sup>	leichtbrennbar	B3
F <sup>II</sup> <sup>1)</sup>		

<sup>1)</sup> Es wird darauf hingewiesen, dass die Europäische Klasse F auch die Tatsache ausdrücken kann, dass noch gar keine Klassifizierung stattgefunden hat.

# Fire Test Certificate – Specimen

**Fabric:** Joelmat  
**Type:** EN13501-1

# J&C Joel

the inspiration behind the performance

